

# **NORTH RIM FAIRWAYS (PWS 5270017) SOURCE WATER ASSESSMENT FINAL REPORT**

---

**June 5, 2002**



## **State of Idaho Department of Environmental Quality**

**Disclaimer:** This publication has been developed as part of an informational service for the source water assessments of public water systems in Idaho and is based on the data available at the time and the professional judgement of the staff. Although reasonable efforts have been made to present accurate information, no guarantees, including expressed or implied warranties of any kind, are made with respect to this publication by the State of Idaho or any of its agencies, employees, or agents, who also assume no legal responsibility for the accuracy of presentations, comments, or other information in this publication. The assessment is subject to modification if new data is produced.

## Executive Summary

Under the Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency (EPA) to assess every source of public drinking water for its relative sensitivity to contaminants regulated by the act. This assessment is based on a land use inventory of the designated assessment area, sensitivity factors associated with the wells, and aquifer characteristics.

This report, *Source Water Assessment for the North Rim Fairways, Jerome, Idaho*, describes the public drinking water system, the boundaries of the zones of water contribution, and the associated potential contaminant sources located within these boundaries. This assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. **The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

Final susceptibility scores are derived from equally weighting system construction scores, hydrologic sensitivity scores, and potential contaminant/land use scores. Therefore, a low rating in one or two categories coupled with a higher rating in other categories results in a final rating of low, moderate, or high susceptibility. With the potential contaminants associated with most urban and heavily agricultural areas, the best score a well can get is moderate. Potential contaminants are divided into four categories, inorganic contaminants (IOCs, i.e. nitrates, arsenic), volatile organic contaminants (VOCs, i.e. petroleum products), synthetic organic contaminants (SOCs, i.e. pesticides), and microbial contaminants (i.e. bacteria). As different wells can be subject to various contamination settings, separate scores are given for each type of contaminant.

The North Rim Fairways (PWS 5270017) drinking water system consists of two ground water well sources. Both wells have a high susceptibility to all potential contaminant categories: IOCs, VOCs, SOCs, and microbial contaminants (Table 2). The multiple potential contaminant sites and the predominant irrigated agricultural land contributed greatly to the overall susceptibility of the wells.

The most significant water chemistry issue for the wells of the North Rim Fairways pertains to the detection of the trihalomethane, bromoform, in the water system. Bromoform, a VOC, was detected in September 2000 at levels far below the MCL. It is a disinfection by-product and it is not a problem with the source water. Though water can never be totally free of by-products when disinfection is used, the amount produced can be controlled by a modification in the treatment process.

No SOCs have been detected in the wells thus far. Total coliform bacteria were detected in the distribution system in July 1999 and September 2000. The IOCs antimony, arsenic, barium, and fluoride were detected in water samples collected from the water system at concentrations far below the maximum contaminant levels (MCLs). Nitrate has also been detected consistently below 2 milligrams per liter (mg/L), a level below the MCL of 10 mg/L. However, the county has been rated as high for nitrogen pesticide use, herbicide use, and total agricultural chemical use. Additionally, the delineation of the wells also crosses a nitrate priority zone.

This assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what ranking a source receives, protection is always important. Whether the source is currently located in a “pristine” area or an area with numerous industrial and/or agricultural land uses that require surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources. If the system should need to expand in the future, new well sites should be located in areas with as few potential sources of contamination as possible, and the site should be reserved and protected for this specific use.

For the North Rim Fairways, drinking water protection activities should first focus on maintaining the requirements of the sanitary survey (an inspection conducted every five years with the purpose of determining the physical condition of a water system’s components and its capacity). Any spills from the potential contaminant sources listed in Table 3, Attachment A of this report should be carefully monitored, as should any future development in the delineated areas. Other practices aimed at reducing the leaching of agricultural chemicals from agricultural land within the designated source water areas should be implemented. Also, disinfection practices should be maintained if microbial contamination becomes a problem. For disinfection by-product control strategies and treatment modification suggestions, see [www.epa.gov](http://www.epa.gov). No chemicals should be stored or applied within the 50-foot radius of the wellhead. Most of the designated areas are outside the direct jurisdiction of the North Rim Fairways, making partnerships with state and local agencies and industry groups critical to success of drinking water protection.

Due to the time involved with the movement of ground water, drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term. A strong public education program should be a primary focus of any drinking water protection plan as the delineations are near urban and residential land uses areas. Public education topics could include proper lawn and garden care practices, household hazardous waste disposal methods, proper care and maintenance of septic systems, and the importance of water conservation to name but a few. There are multiple resources available to help communities implement protection programs, including the Drinking Water Academy of the EPA. There are major transportation corridors through the delineation; therefore the State Department of Transportation should be involved in protection activities. Drinking water protection activities for agriculture should be coordinated with the Idaho State Department of Agriculture, the Soil Conservation Commission, the local Soil Conservation District, and the Natural Resources Conservation Service.

A system must incorporate a variety of strategies in order to develop a comprehensive drinking water protection plan, be they regulatory in nature (i.e. zoning, permitting) or non-regulatory in nature (i.e. good housekeeping, public education, specific best management practices). For assistance in developing protection strategies please contact the Twin Falls Regional Office of the Idaho Department of Environmental Quality or the Idaho Rural Water Association.

# SOURCE WATER ASSESSMENT FOR THE NORTH RIM FAIRWAYS, JEROME, IDAHO

## Section 1. Introduction - Basis for Assessment

The following sections contain information necessary to understand how and why this assessment was conducted. **It is important to review this information to understand what the rankings of this assessment mean.** Maps showing the delineated source water assessment areas and the inventory of significant potential sources of contamination identified within those areas are attached. The lists of significant potential contaminant source categories and their rankings, used to develop this assessment, are also attached.

### Level of Accuracy and Purpose of the Assessment

The Idaho Department of Environmental Quality (DEQ) is required by the EPA to assess the over 2,900 public drinking water sources in Idaho for their relative susceptibility to contaminants regulated by the Safe Drinking Water Act. This assessment is based on a land use inventory of the delineated assessment area, sensitivity factors associated with the wells, and aquifer characteristics. All assessments must be completed by May of 2003. The resources and time available to accomplish assessments are limited. Therefore, an in-depth, site-specific investigation to identify each significant potential source of contamination for every public water system is not possible. **This assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

The ultimate goal of this assessment is to provide data to local communities to develop a protection strategy for their drinking water supply system. The DEQ recognizes that pollution prevention activities generally require less time and money to implement than treating a public water supply system once it has been contaminated. DEQ encourages communities to balance resource protection with economic growth and development. The decision as to the amount and types of information necessary to develop a drinking water protection program should be determined by the local community based on its own needs and limitations. Drinking water protection is one facet of a comprehensive growth plan, and it can complement ongoing local planning efforts.

## **Section 2. Conducting the Assessment**

### **General Description of the Source Water Quality**

The North Rim Fairways drinking water system includes two community wells that serve a population of 137 through 74 connections. The wells are 6 miles south of the city of Jerome in Jerome County. Both wells are located in a well lot, approximately one-half mile north of the entrance to the North Rim Fairways country club and golf course (Figure 1).

Well #2, drilled in 1978, is a secondary, supplementary water source due to problems with pumping sand. Well #1 is the main well that provides drinking water to the facility. The water from the North Rim Fairways wells is pumped to a 7700-gallon steel storage tank located in the same lot as the wells. The water is treated only when required, by the addition of sodium hypochlorite into storage tank.

The only VOC to be detected in the wells of the North Rim Fairways pertains to the detection of the trihalomethane, bromoform, in the water system. Bromoform, a VOC, was detected as a disinfection by-product in September 2000 at levels below the MCL. Though water can never be totally free of by-products when disinfection is used, the amount produced can be controlled by a modification in the treatment process.


No SOCs have been detected in the wells thus far. Total coliform bacteria were detected in the distribution system in July 1999 and September 2000. The IOCs antimony, arsenic, barium, and fluoride were detected in water samples collected from the water system at concentrations far below the MCLs. Nitrate has also been detected consistently below 2 mg/L. The MCL for nitrate is 10 mg/L. However, the county has been rated as high for nitrogen pesticide use, herbicide use, and total agricultural chemical use. The delineated areas of the wells also cross a nitrate priority zone.

### **Defining the Zones of Contribution – Delineation**

The delineation process establishes the physical area around a well that will become the focal point of the assessment. The process includes mapping the boundaries of the zone of contribution into time-of-travel zones (zones indicating the number of years necessary for a particle of water to reach a well) for water in the aquifer. Washington Group, International (WGI) used a refined computer model approved by the EPA in determining the time-of-travel (TOT) zones for water associated with the Southwest Eastern Snake River Plain (SW ESRP) aquifer. The computer model used site-specific data, assimilated by DEQ and WGI from a variety of sources including local area well logs and hydrogeologic reports summarized below.

The ESRP is a northeast trending basin located in southeastern Idaho. The 10,000 square miles of the plain are filled primarily with highly fractured layered Quaternary basalt flows of the Snake River Group, which are intercalated with sedimentary rocks along the margins (Garabedian, 1992, p. 5). Individual basalt flows range from 10 to 50 feet thick, averaging 20 to 25 feet thick (Lindholm, 1996, p. 14). Basalt is thickest in the central part of the eastern plain and thins toward the margins. Whitehead (1992, p. 9) estimates the total thickness of the flows to be as great as 5,000 feet. A thin layer (0 to 100 feet) of windblown and fluvial sediments overlies the basalt.

**FIGURE 1. Geographic Location of North Rim Fairways**

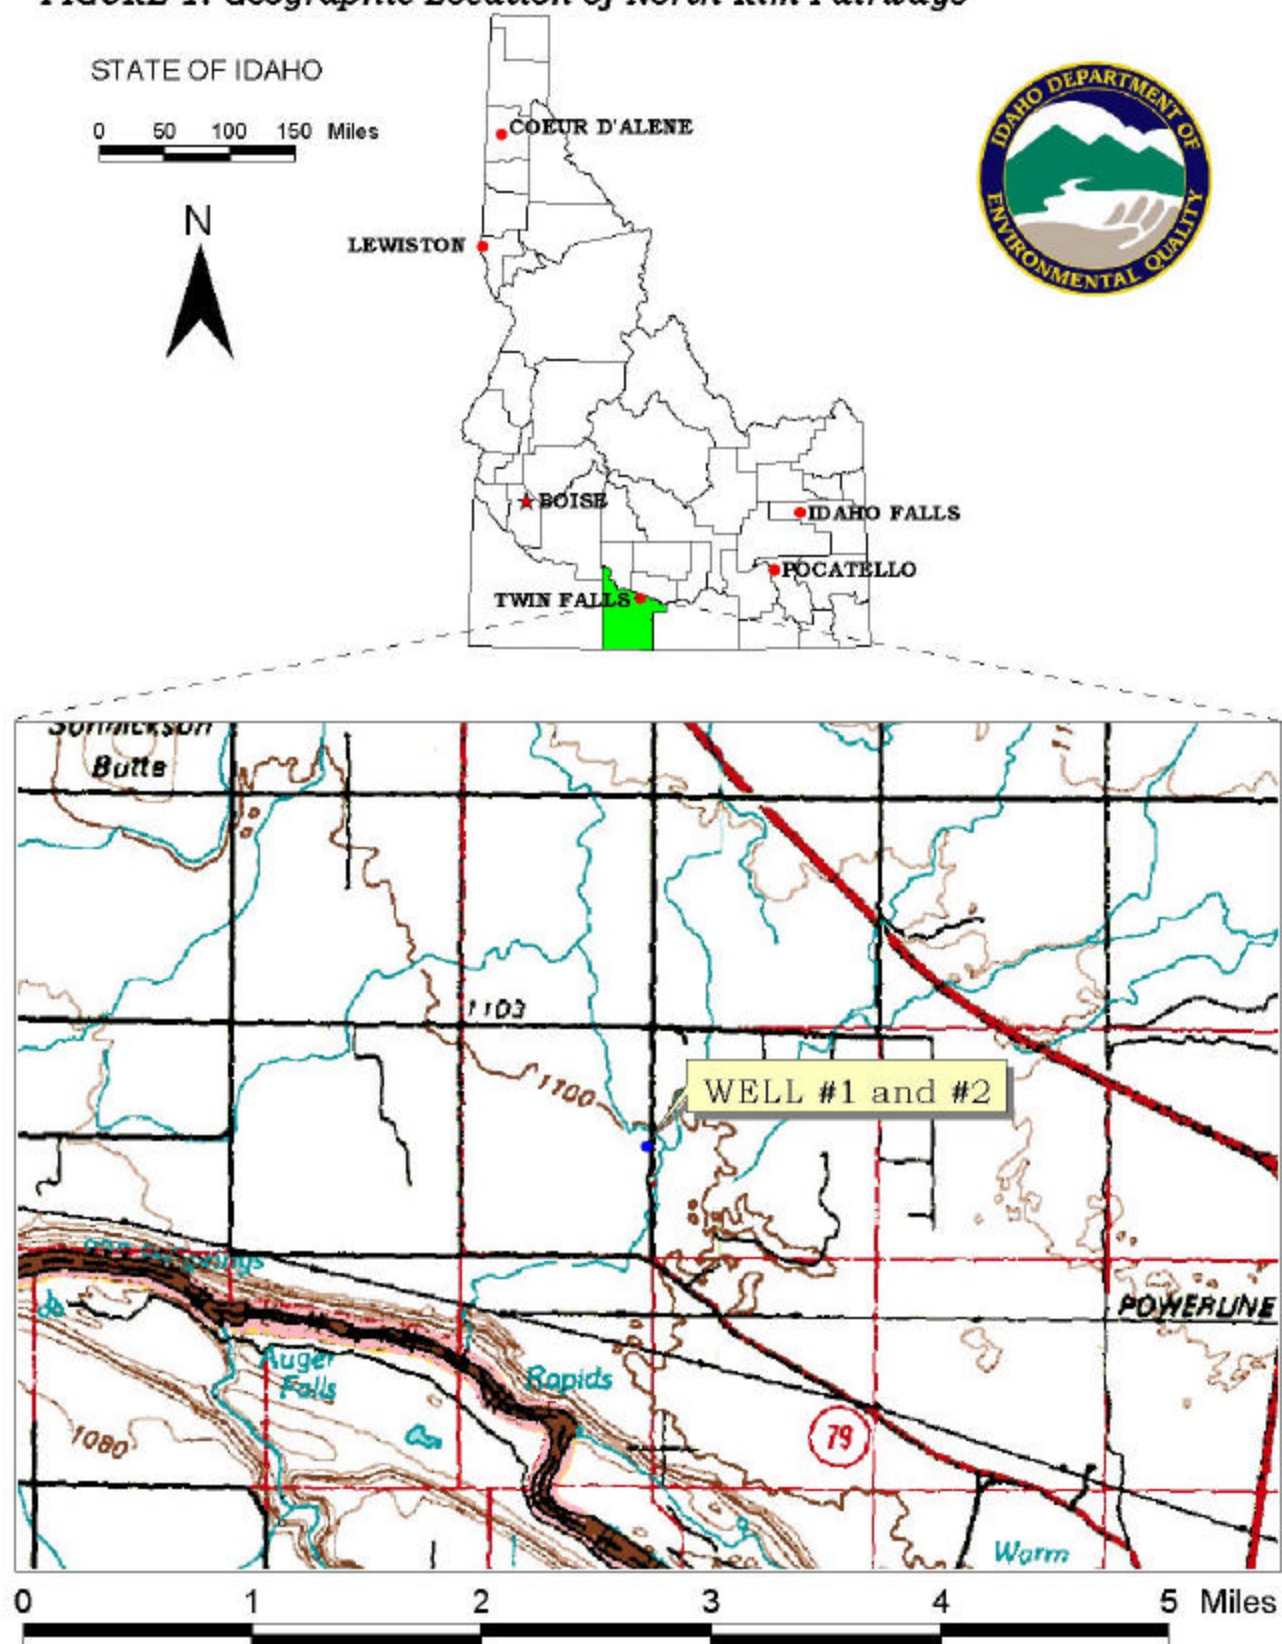

The layered basalts of the Snake River Group host one of the most productive aquifers in the United States. The aquifer is generally considered unconfined, yet may be confined locally because of interbedded clay and dense unfractured basalt (Whitehead, 1992, p. 26). Whitehead (1992, p. 22) reports that well yields of 2,000 to 3,000 gal/min are common for wells open to less than 100 feet of the aquifer. Lindholm (1996, p. 18) estimates aquifer thickness to range from 100 feet near the plain's margin to thousands of feet near the center. Models of the regional aquifer have used values ranging from 200 to 3,000 feet to represent aquifer thickness (Cosgrove et al., 1999, p. 15).

Regional ground-water flow is to the southwest paralleling the basin (Cosgrove et al., 1999; deSonneville, 1972, p. 78; Garabedian, 1992, p. 48; and Lindholm, 1996, p. 23). Reported water table gradients range from 3 to 100 ft/mile and average 12 ft/mile (Lindholm, 1996, p. 22). Gradients steepen at the plain's margin and at discharge locations.

The majority of aquifer recharge results from surface water irrigation activities (incidental recharge), which divert water from the Snake River and its tributaries (Ackerman, 1995, p. 4, and Garabedian, 1992, p. 11). Natural recharge occurs through stream losses, direct precipitation, and tributary basin underflow.

The Southwest Margin of the ESRP hydrologic province is the regional aquifer's primary discharge area. Interpretation of well logs indicates that a 1- to 23-foot-thick layer of sediment overlies the fractured basalt aquifer in Jerome County, and that an 8- to 410-foot-thick layer of sediment overlies the same aquifer in southern Minidoka and Power Counties. Published geologic maps of the Snake River Plain (Whitehead 1992, Plates 1 and 5) indicate there is 100 to 500 feet of Quaternary to Tertiary Basalts aged compacted to poorly consolidated sediments located in the Heyburn area (north of the Snake River near Burley). The saturated thickness of the regional basalt aquifer for the Southwest Margin is estimated to range from less than 500 feet near the Snake River to 1,500 feet near Minidoka.

A published water table map of the Kimberly to Bliss region of the aquifer (Moreland, 1976, p. 5) indicates that the ground-water flow direction in the Southwest Margin is similar to that depicted at the regional scale (e.g., Garabedian, 1992, Plate 4).

Annual average precipitation for the period 1951 to 1980 is 9.6 inches in both Twin Falls and Burley (Kjelstrom, 1995, p. 3). The estimated recharge from precipitation in the Southwest Margin ranges from less than 0.5 inch to more than 2 in./yr (Garabedian, 1992, p. 20). Kjelstrom (1995, p. 13) reports an annual river loss of 110,000 acre-feet to the aquifer for the 34.8-mile Minidoka-to-Milner reach of the Snake River. River gains of 210,000 acre-feet for the 21.5-mile Milner-to-Kimberly reach, and 880,000 acre-feet for the 20.4-mile Kimberly-to-Buhl reach are reported for the same period.

The wells of the North Rim Fairways share the same delineation. That delineated source water assessment area can best be described as a pie-shaped corridor extending approximately 45 miles to the east from the wellheads (Figure 2, Attachment A). The actual data used by WGI in determining the source water assessment delineation area is available from DEQ upon request.

## **Identifying Potential Sources of Contamination**

A potential source of contamination is defined as any facility or activity that stores, uses, or produces, as a product or by-product, the contaminants regulated under the Safe Drinking Water Act and has a sufficient likelihood of releasing such contaminants at levels that could pose a concern relative to drinking water sources. The goal of the inventory process is to locate and describe those facilities,

land uses, and environmental conditions that are potential sources of ground water contamination. The locations of potential sources of contamination within the delineation areas were obtained by field surveys conducted by DEQ and the North Rim Fairways and from available databases.

The dominant land use outside the area of the North Rim Fairways is predominantly irrigated agriculture and rangeland. Land use within the immediate area of the wellhead consists of residential property and irrigated agriculture.

It is important to understand that a release may never occur from a potential source of contamination provided best management practices are used at the facility. Many potential sources of contamination are regulated at the federal level, state level, or both, to reduce the risk of release. Therefore, when a business, facility, or property is identified as a potential contaminant source, this should not be interpreted to mean that this business, facility, or property is in violation of any local, state, or federal environmental law or regulation. What it does mean is that the potential for contamination exists due to the nature of the business, industry, or operation. There are a number of methods that water systems can use to work cooperatively with potential sources of contamination, such as educational visits and inspections of stored materials. Many owners of such facilities may not even be aware that they are located near a public water supply well.

### **Contaminant Source Inventory Process**

A contaminant inventory of the study area was conducted in June and July of 2001. This involved identifying and documenting potential contaminant sources within the North Rim Fairways Source Water Assessment Areas through the use of computer databases and Geographic Information System maps developed by DEQ.

The delineation of the North Rim Fairways wells has 96 potential point sources (Table 3, Attachment A). These potential contaminant sources include several deep injection wells, some dairies, a gravel pit, an underground storage tank (UST), a site regulated under the Superfund Amendments and Reauthorization Act (SARA), various businesses, and an active landfill. The GIS map shows that the delineation crosses Interstate 84 in the 10-year time of travel (TOT) zone. This is a major transportation corridor that can contribute contaminants to the aquifer in the event of an accidental spill or release.

### **Section 3. Susceptibility Analyses**

Each well's susceptibility to contamination was ranked as high, moderate, or low risk according to the following considerations: hydrologic characteristics, physical integrity of the well, land use characteristics, and potentially significant contaminant sources. The susceptibility rankings are specific to a particular potential contaminant or category of contaminants. Therefore, a high susceptibility rating relative to one potential contaminant does not mean that the water system is at the same risk for all other potential contaminants. The relative ranking that is derived for each well is a qualitative, screening-level step that, in many cases, uses generalized assumptions and best professional judgement. Attachment B contains the susceptibility analysis worksheets. The following summaries describe the rationale for the susceptibility ranking.



## Hydrologic Sensitivity

The hydrologic sensitivity of a well is dependent upon four factors: the surface soil composition, the material in the vadose zone (between the land surface and the water table), the depth to first ground water, and the presence of a 50-foot thick fine-grained zone above the producing zone of the well. Slowly draining soils such as silt and clay typically are more protective of ground water than coarse-grained soils such as sand and gravel. Similarly, fine-grained sediments in the subsurface and a water depth of more than 300 feet protect the ground water from contamination.

The hydrologic sensitivity was high for both wells (Table 2). This rating reflects the moderate-to-well drained nature of the soil of the region. Additionally, the well logs indicate that the vadose zone is composed predominantly of fractured lava and gravel layers. First ground water was found between 155 feet and 160 feet below ground surface (bgs) for Well #2 and between 90 feet and 96 feet bgs for Well #1.

## Well Construction

Well construction directly affects the ability of the well to protect the aquifer from contaminants. System construction scores are reduced when information shows that potential contaminants will have a more difficult time reaching the intake of the well. Lower scores imply a system is less vulnerable to contamination. For example, if the well casing and annular seal both extend into a low permeability unit, then the possibility of contamination is reduced and the system construction score goes down. If the highest production interval is more than 100 feet below the water table, then the system is considered to have better buffering capacity. If the wellhead and surface seal are maintained to standards, as outlined in Sanitary Surveys, then contamination down the well bore is less likely. If the well is protected from surface flooding and is outside the 100-year floodplain, then contamination from surface events is reduced.

The drinking water wells of the North Rim Fairways both have a moderate system construction score (Table 2). The 1997 sanitary survey indicates that the wells are protected from surface flooding and that the wellhead and surface seals are maintained to standards. Table 1 below describes the system construction information obtained from available well logs for each well.

**Table 1. North Rim Fairways Well Construction Summary Information**

Well	Well Depth (ft)	Water Table Depth (ft)	Casing: diameter/ thickness (in)	Casing: depth (ft)/ formation	Surface seal: depth (ft)/ formation	Screened Interval (ft)	Drill Year	Sanitary Survey Elements (A/B) <sup>1</sup>
Well #1	325	140	10/0.250	205/gray lava	NI	None	1991	Yes/Yes
Well #2	570	352	8/0.250	294/hard gray basalt	18/hard gray basalt	None	1978	Yes/Yes

<sup>1</sup> A = Well and surface seal in compliance; B = Protected from surface flooding  
NI = no information was available

Though the wells of the North Rim Fairways may have met standards at the time of construction, current well construction standards are stricter. The Idaho Department of Water Resources *Well Construction Standards Rules* (1993) require all Public Water Systems (PWSs) to follow DEQ standards as well. IDAPA 58.01.08.550 requires that PWSs follow the *Recommended Standards for Water Works* (1997) during construction. Some of the requirements include casing thickness, well tests, and depth and formation type that the surface seal must be installed into. Table 1 of the

*Recommended Standards for Water Works* (1997) lists the required steel casing thickness for various diameter wells. Eight-inch diameter wells require a casing thickness of at least 0.322-inches. Ten-inch diameter wells require a casing thickness of at least 0.365 inches. Well tests are required at the design pumping rate for 24 hours or until stabilized drawdown has continued for at least six hours when pumping at 1.5 times the design pumping rate.

### Potential Contaminant Source and Land Use

Both of the North Rim Fairways wells rate high for IOCs (e.g. arsenic, nitrate), VOCs (e.g. petroleum products), and SOC (e.g. pesticides) and moderate for microbial contaminants (e.g. bacteria) (Table 2). The number of potential contaminant sources within the delineation contributed to the land use ratings for both wells.

### Final Susceptibility Rating

An IOC detection above a drinking water standard MCL, any detection of a VOC or SOC, or a detection of total coliform bacteria or fecal coliform bacteria at the wellhead will automatically give a high susceptibility rating to a well, despite the land use of the area, because a pathway for contamination already exists. Additionally, the storage or application of any potential contaminants within 50 feet of the wellhead will automatically lead to a high score. Hydrologic sensitivity and system construction scores are heavily weighted in the final scores. Having multiple potential contaminant sources in the 0- to 3-year time-of-travel zone (Zone 1B) and much agricultural land contribute greatly to the overall ranking. In terms of total susceptibility, both wells of the North Rim Fairways have a high susceptibility to all potential contaminant categories (Table 2).

**Table 2. Summary of the North Rim Fairways Susceptibility Evaluation**

Source	Susceptibility Scores <sup>1</sup>									
	Hydrologic Sensitivity	Contaminant Inventory				System Construction	Final Susceptibility Ranking			
		IOC	VOC	SOC	Microbials		IOC	VOC	SOC	Microbials
Well #1	H	H	H	H	M	M	H	H	H	H
Well #2	H	H	H	H	M	M	H	H	H	H

<sup>1</sup>H = High Susceptibility, M = Moderate Susceptibility, L = Low Susceptibility

IOC = inorganic chemical, VOC = volatile organic chemical, SOC = synthetic organic chemical

### Susceptibility Summary

In terms of total susceptibility, both wells of the North Rim Fairways have a high susceptibility to all potential contaminant categories. The multiple potential contaminant sites and the predominant irrigated agricultural land surrounding the wells as well as the high hydrologic sensitivity score contributed to the overall susceptibility of the wells of the North Rim Fairways.

The only VOC in the wells of the North Rim Fairways pertains to the detection of the trihalomethane, bromoform, in the water system. Bromoform, a VOC, was detected in September 2000 at levels below the MCL. It is a disinfection by-product and is not a problem of the source water. Though water can never be totally free of by-products when disinfection is used, the amount produced can be controlled by treatment modifications.

No SOC's have been detected in the wells thus far. Total coliform bacteria were detected in the distribution system in July 1999 and September 2000. The IOC's antimony, arsenic, barium, and fluoride were detected in water samples collected from the water system at concentrations far below the MCLs. Nitrate has also been detected consistently below 2 mg/L, a level below the MCL of 10 mg/L. However, the county has been rated as high for nitrogen pesticide use, herbicide use, and total agricultural chemical use. The delineated areas of the wells also cross a nitrate priority zone.

## **Section 4. Options for Drinking Water Protection**

The susceptibility assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what the susceptibility ranking a source receives, protection is always important. Whether the source is currently located in a "pristine" area or an area with numerous industrial and/or agricultural land uses that require surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources.

An effective drinking water protection program is tailored to the particular local drinking water protection area. A community with a fully developed drinking water protection program will incorporate many strategies, be they regulatory in nature (i.e. zoning, permitting) or non-regulatory in nature (i.e. good housekeeping, public education, specific best management practices). For the North Rim Fairways, drinking water protection activities should first focus on maintaining the requirements of the sanitary survey. Any spills from the potential contaminant sources listed in Table 1 Attachment A of this report should be carefully monitored, as should any future development in the delineated areas. Other practices aimed at reducing the leaching of agricultural chemicals from agricultural land within the designated source water areas should be implemented. Also, disinfection practices should be maintained if microbial contamination becomes a problem. For disinfection by-product control strategies, see [www.epa.gov](http://www.epa.gov). No chemicals should be stored or applied within the 50-foot radius of the wellhead. Most of the designated areas are outside the direct jurisdiction of the North Rim Fairways, making partnerships with state and local agencies and industry groups critical to success of drinking water protection.

Due to the time involved with the movement of ground water, drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term. A strong public education program should be a primary focus of any drinking water protection plan as the delineations are near urban and residential land use areas. Public education topics could include proper lawn and garden care practices, household hazardous waste disposal methods, proper care and maintenance of septic systems, and the importance of water conservation to name but a few. There are multiple resources available to help communities implement protection programs, including the Drinking Water Academy of the EPA. There are major transportation corridors that cross the delineations, therefore the State Department of Transportation should be involved in protection activities. Drinking water protection activities for agriculture should be coordinated with the Idaho State Department of Agriculture, the Soil Conservation Commission, the local Soil Conservation District, and the Natural Resources Conservation Service.

A system must incorporate a variety of strategies in order to develop a comprehensive drinking water protection plan, be they regulatory in nature (i.e. zoning, permitting) or non-regulatory in nature (i.e. good housekeeping, public education, specific best management practices). For assistance in developing protection strategies please contact the Twin Falls Regional Office of the Idaho Department of Environmental Quality or the Idaho Rural Water Association.

## **Assistance**

Public water suppliers and others may call the following DEQ offices with questions about this assessment and to request assistance with developing and implementing a local protection plan. In addition, draft protection plans may be submitted to the DEQ office for preliminary review and comments.

Twin Falls Regional DEQ Office (208) 736-2190

State DEQ Office (208) 373-0502

Website: <http://www.deq.state.id.us>

Water suppliers serving fewer than 10,000 persons may contact Melinda Harper, (mlharper@idahoruralwater.com) Idaho Rural Water Association, at (208) 343-7001 for assistance with drinking water protection (formerly wellhead protection) strategies.

## POTENTIAL CONTAMINANT INVENTORY LIST OF ACRONYMS AND DEFINITIONS

**AST (Aboveground Storage Tanks)** – Sites with aboveground storage tanks.

**Business Mailing List** – This list contains potential contaminant sites identified through a yellow pages database search of standard industry codes (SIC).

**CERCLIS** – This includes sites considered for listing under the **Comprehensive Environmental Response Compensation and Liability Act (CERCLA)**. CERCLA, more commonly known as ASuperfund, is designed to clean up hazardous waste sites that are on the national priority list (NPL).

**Cyanide Site** – DEQ permitted and known historical sites/facilities using cyanide.

**Dairy** – Sites included in the primary contaminant source inventory represent those facilities regulated by Idaho State Department of Agriculture (ISDA) and may range from a few head to several thousand head of milking cows.

**Deep Injection Well** – Injection wells regulated under the Idaho Department of Water Resources generally for the disposal of stormwater runoff or agricultural field drainage.

**Enhanced Inventory** – Enhanced inventory locations are potential contaminant source sites added by the water system. These can include new sites not captured during the primary contaminant inventory, or corrected locations for sites not properly located during the primary contaminant inventory. Enhanced inventory sites can also include miscellaneous sites added by the Idaho Department of Environmental Quality (DEQ) during the primary contaminant inventory.

**Floodplain** – This is a coverage of the 100-year floodplains.

**Group 1 Sites** – These are sites that show elevated levels of contaminants and are not within the priority one areas.

**Inorganic Priority Area** – Priority one areas where greater than 25% of the wells/springs show constituents higher than primary standards or other health standards.

**Landfill** – Areas of open and closed municipal and non-municipal landfills.

**LUST (Leaking Underground Storage Tank)** – Potential contaminant source sites associated with leaking underground storage tanks as regulated under RCRA.

**Mines and Quarries** – Mines and quarries permitted through the Idaho Department of Lands.

**Nitrate Priority Area** – Area where greater than 25% of wells/springs show nitrate values above 5mg/l.

**NPDES (National Pollutant Discharge Elimination System)** – Sites with NPDES permits. The Clean Water Act requires that any discharge of a pollutant to waters of the United States from a point source must be authorized by an NPDES permit.

**Organic Priority Areas** – These are any areas where greater than 25 % of wells/springs show levels greater than 1% of the primary standard or other health standards.

**Recharge Point** – This includes active, proposed, and possible recharge sites on the Snake River Plain.

**RICRIS** – Site regulated under **Resource Conservation Recovery Act (RCRA)**. RCRA is commonly associated with the cradle to grave management approach for generation, storage, and disposal of hazardous wastes.

**SARA Tier II (Superfund Amendments and Reauthorization Act Tier II Facilities)** – These sites store certain types and amounts of hazardous materials and must be identified under the Community Right to Know Act.

**Toxic Release Inventory (TRI)** – The toxic release inventory list was developed as part of the Emergency Planning and Community Right to Know (Community Right to Know) Act passed in 1986. The Community Right to Know Act requires the reporting of any release of a chemical found on the TRI list.

**UST (Underground Storage Tank)** – Potential contaminant source sites associated with underground storage tanks regulated as regulated under RCRA.

**Wastewater Land Applications Sites** – These are areas where the land application of municipal or industrial wastewater is permitted by DEQ.

**Wellheads** – These are drinking water well locations regulated under the Safe Drinking Water Act. They are not treated as potential contaminant sources.

**NOTE:** Many of the potential contaminant sources were located using a geocoding program where mailing addresses are used to locate a facility. Field verification of potential contaminant sources is an important element of an enhanced inventory.

Where possible, a list of potential contaminant sites unable to be located with geocoding will be provided to water systems to determine if the potential contaminant sources are located within the source water assessment area.

## References Cited

- Ackerman, D.J., 1995, *Analysis of Steady-State Flow and Advective Transport in the Eastern Snake River Plain Aquifer System, Idaho*, U.S. Geological Survey Water-Resources Investigations Report 94-4257, 25 p. I-FY95.
- Cosgrove, D.M., G.S. Johnson, S. Laney, and J. Lindgren, 1999, *Description of the IDWR/UI Snake River Plain Aquifer Model (SRPAM)*, Idaho Water Resources Research Institute, University of Idaho, 95 p.
- deSonneville, J.L.J., 1972, *Development of a Mathematical Groundwater Model*, Water Resources Research Institute, University of Idaho, Moscow, Idaho, 227 p.
- Garabedian, S.P., 1992, *Hydrology and Digital Simulation of the Regional Aquifer System, Eastern Snake River Plain, Idaho*, U.S. Geological Survey Professional Paper 1408-F, 102 p., 10 pl. I-FY92.
- Great Lakes-Upper Mississippi River Board of State and Provincial Public Health and Environmental Managers, 1997. "Recommended Standards for Water Works."
- Idaho Department of Environmental Quality, 1997. *Design Standards for Public Drinking Water Systems*. IDAPA 58.01.08.550.01.
- Idaho Department of Water Resources, 1993. *Administrative Rules of the Idaho Water Resource Board: Well Construction Standards Rules*. IDAPA 37.03.09.
- Kjelstrom, L.C., 1995, *Streamflow Gains and Losses in the Snake River and Ground-Water Budgets for the Snake River Plain, Idaho and Eastern Oregon*, U.S. Geological Survey Professional Paper 1408-C, 47 p. I-FY95.
- Lindholm, G.F., 1996, *Summary of the Snake River Plain Regional Aquifer-System analysis in Idaho and Eastern Oregon*, U.S. Geological Survey Professional Paper 1408-A, 59 p.
- Moreland, J.A., 1976, *Digital-Model Analysis of the Effects of Water-Use Alternatives on Spring Discharges, Gooding and Jerome Counties, Idaho*, U.S. Geological Survey and Idaho Department of Water Resources, Water Information Bulletin No.42, 46p.
- Whitehead, R.L., 1992, *Geohydrologic Framework of the Snake River Plain Regional Aquifer System, Idaho and Eastern Oregon*, U.S. Geological Survey Professional Paper 1408-B, 32p. I-FY92

## Attachment A

### North Rim Fairways Table 3, Figure 2

**Table 3. Wells #1 and #2. Potential Contaminant Inventory**

Site	Source Description <sup>1</sup>	TOT <sup>2</sup> Zone	Source of Information	Potential Contaminants <sup>3</sup>
1, 5	LUST-Site Cleanup Completed , Impact: Unknown, UST-Closed	0 – 3	Database Search	VOC, SOC
2	UST-Open	0 – 3	Database Search	VOC, SOC
3	UST-Open	0 – 3	Database Search	VOC, SOC
4	UST-Open	0 – 3	Database Search	VOC, SOC
6	UST-Closed	0 – 3	Database Search	VOC, SOC
7	Dairy<=200 cows	0 – 3	Database Search	IOC, Microbials
8	Dairy<=200 cows	0 – 3	Database Search	IOC, Microbials
9	Dairy<=200 cows	0 – 3	Database Search	IOC, Microbials
10	Dairy<=200 cows	0 – 3	Database Search	IOC, Microbials
11	Dairy<=200 cows	0 – 3	Database Search	IOC, Microbials
12	Dairy 201-500 cows	0 – 3	Database Search	IOC, Microbials
13	Dairy 201-500 cows	0 – 3	Database Search	IOC, Microbials
14	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
15	Deep Injection Well-Temporary Abandon	0 – 3	Database Search	IOC, VOC, SOC
16	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
17	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
18	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
19	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
20	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
21	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
22	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
23	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
24	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
25	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
26	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
27	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
28	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
29	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
30	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
31	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
32	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
33	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
34	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
35	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
36	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
37	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
38	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
39	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
40	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
41	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
42	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
43	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
44	Deep Injection Well-Temporary Abandon	0 – 3	Database Search	IOC, VOC, SOC
45	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
46	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
47	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
48	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
49	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
50	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC




Site	Source Description <sup>1</sup>	TOT <sup>2</sup> Zone	Source of Information	Potential Contaminants <sup>3</sup>
51	Deep Injection Well-Temporary Abandon	0 – 3	Database Search	IOC, VOC, SOC
52	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
53	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
54	Deep Injection Well-Permanent Abandon	0 – 3	Database Search	IOC, VOC, SOC
55	Deep Injection Well-Active	0 – 3	Database Search	IOC, VOC, SOC
56	WLAP Site-Municipal	0 – 3	Database Search	IOC, VOC, SOC, Microbials
57	Dairy<=200 cows	3 – 6	Database Search	IOC
58	Dairy<=200 cows	3 – 6	Database Search	IOC
59	Dairy<=200 cows	3 – 6	Database Search	IOC
60	Mine	3 – 6	Database Search	IOC, VOC, SOC
61	Mine	3 – 6	Database Search	IOC, VOC, SOC
62	UST-Closed	6 – 10	Database Search	VOC, SOC
63	Dairy 201-500 cows	6 – 10	Database Search	IOC
64	Dairy 201-500 cows	6 – 10	Database Search	IOC
65	Dairy 201-500 cows	6 – 10	Database Search	IOC
66	Dairy 2501-750 cows	6 – 10	Database Search	IOC
67	Plumbing Drain & Sewer Cleaning	6 – 10	Database Search	IOC, SOC
68	Feed-Dealers (Wholesale)	6 – 10	Database Search	IOC, SOC
69	Automobile Dealers-Used Cars	6 – 10	Database Search	VOC, SOC
70	Farm Equipment (Wholesale)	6 – 10	Database Search	IOC, VOC, SOC
71	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
72	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
73	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
74	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
75	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
76	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
77	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
78	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
79	Deep Injection Well-Location/Status Unknown	6 – 10	Database Search	IOC, VOC, SOC
80	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
81	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
82	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
83	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
84	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
85	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
86	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
87	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
88	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
89	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
90	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
91	Deep Injection Well-Active	6 – 10	Database Search	IOC, VOC, SOC
92	SARA Site	6 – 10	Database Search	IOC, VOC, SOC
93	SARA Site	6 – 10	Database Search	IOC, SOC
94	Recharge	6 – 10	Database Search	IOC, VOC, SOC
95	Recharge	6 – 10	Database Search	IOC, VOC, SOC
96	Landfill-Active	6 – 10	Database Search	IOC, VOC, SOC
	Interstate 84	6 – 10	GIS Map	IOC, VOC, SOC

<sup>1</sup> LUST = leaking underground storage tank, UST = underground storage tank, SARA = Superfund Amendments and Reauthorization Act

<sup>2</sup> TOT = time-of-travel (in years) for a potential contaminant to reach the wellhead

<sup>3</sup> IOC = inorganic chemical, VOC = volatile organic chemical, SOC = synthetic organic chemical

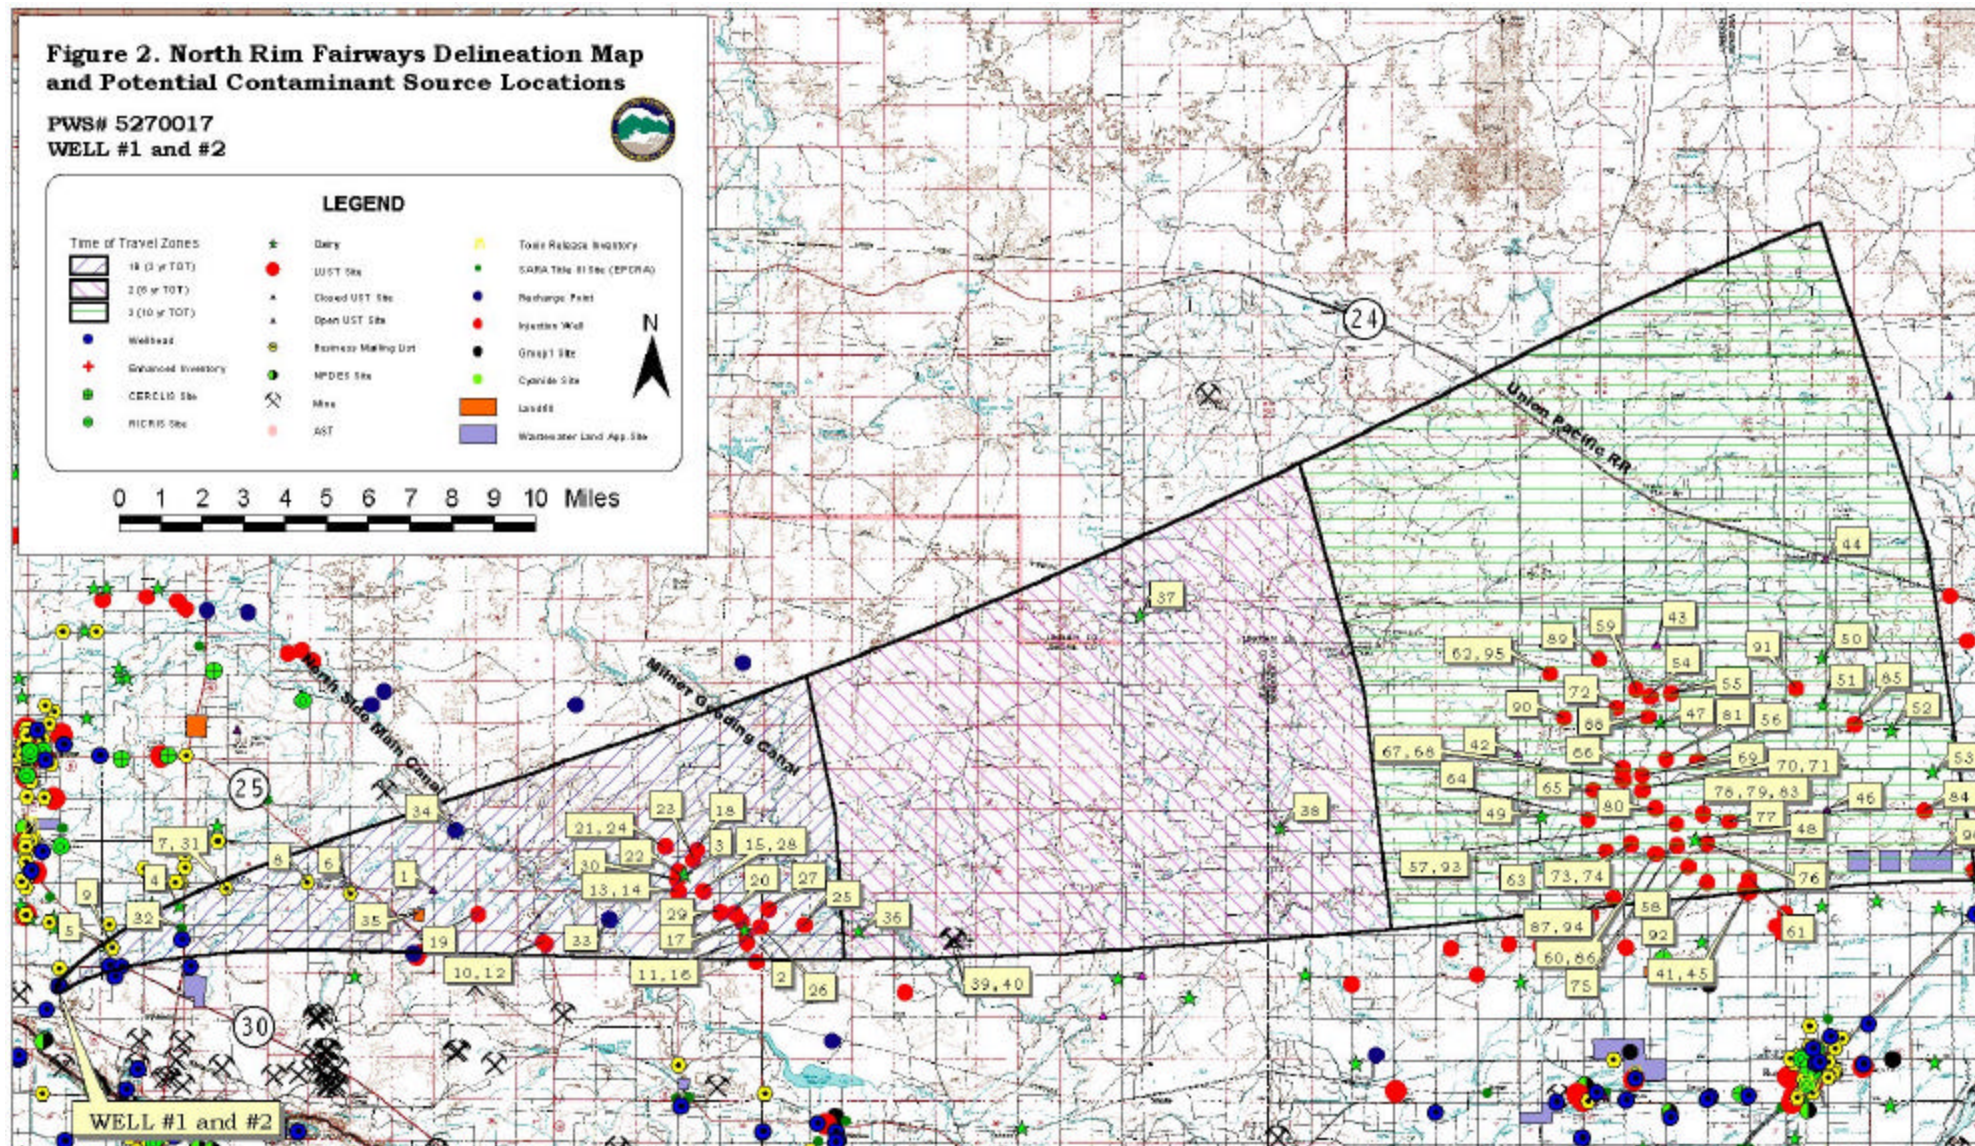

## Attachment B

### North Rim Fairways Susceptibility Analysis Worksheets

The final scores for the susceptibility analysis were determined using the following formulas:

- 1) VOC/SOC/IOC Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.2)
- 2) Microbial Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.375)

Final Susceptibility Scoring:

0 - 5    Low Susceptibility

6 - 12   Moderate Susceptibility

≥ 13    High Susceptibility



1. System Construction		SCORE			
Drill Date	4/1/1991				
Driller Log Available	YES				
Sanitary Survey (if yes, indicate date of last survey)	YES	1996			
Well meets IDWR construction standards	NO	1			
Wellhead and surface seal maintained	YES	0			
Casing and annular seal extend to low permeability unit	NO	2			
Highest production 100 feet below static water level	NO	1			
Well located outside the 100 year flood plain	YES	0			
Total System Construction Score		4			
2. Hydrologic Sensitivity					
Soils are poorly to moderately drained	NO	2			
Vadose zone composed of gravel, fractured rock or unknown	YES	1			
Depth to first water > 300 feet	NO	1			
Aquitard present with > 50 feet cumulative thickness	NO	2			
Total Hydrologic Score		6			
3. Potential Contaminant / Land Use - ZONE 1A		IOC Score	VOC Score	SOC Score	Microbial Score
Land Use Zone 1A	IRRIGATED CROPLAND	2	2	2	2
Farm chemical use high	YES	2	0	2	
IOC, VOC, SOC, or Microbial sources in Zone 1A	NO	NO	NO	NO	NO
Total Potential Contaminant Source/Land Use Score - Zone 1A		4	2	4	2
Potential Contaminant / Land Use - ZONE 1B					
Contaminant sources present (Number of Sources)	YES	50	48	48	8
(Score = # Sources X 2 ) 8 Points Maximum		8	8	8	8
Sources of Class II or III leacheable contaminants or	YES	8	6	6	
4 Points Maximum		4	4	4	
Zone 1B contains or intercepts a Group 1 Area	YES	2	0	0	0
Land use Zone 1B Greater Than 50% Irrigated Agricultural Land		4	4	4	4
Total Potential Contaminant Source / Land Use Score - Zone 1B		18	16	16	12
Potential Contaminant / Land Use - ZONE II					
Contaminant Sources Present	YES	2	2	2	
Sources of Class II or III leacheable contaminants or	YES	1	1	1	
Land Use Zone II 25 to 50% Irrigated Agricultural Land		1	1	1	
Potential Contaminant Source / Land Use Score - Zone II		4	4	4	0
Potential Contaminant / Land Use - ZONE III					
Contaminant Source Present	YES	1	1	1	
Sources of Class II or III leacheable contaminants or	YES	1	1	1	
Is there irrigated agricultural lands that occupy > 50% of	YES	1	1	1	
Total Potential Contaminant Source / Land Use Score - Zone III		3	3	3	0
Cumulative Potential Contaminant / Land Use Score		29	25	27	14
4. Final Susceptibility Source Score		16	15	15	15
5. Final Well Ranking		High	High	High	High

1. System Construction		SCORE			
Drill Date	9/22/1978				
Driller Log Available	YES				
Sanitary Survey (if yes, indicate date of last survey)	YES	1996			
Well meets IDWR construction standards	NO	1			
Wellhead and surface seal maintained	YES	0			
Casing and annular seal extend to low permeability unit	NO	2			
Highest production 100 feet below static water level	NO	1			
Well located outside the 100 year flood plain	YES	0			
Total System Construction Score		4			
2. Hydrologic Sensitivity					
Soils are poorly to moderately drained	NO	2			
Vadose zone composed of gravel, fractured rock or unknown	YES	1			
Depth to first water > 300 feet	NO	1			
Aquitard present with > 50 feet cumulative thickness	NO	2			
Total Hydrologic Score		6			
3. Potential Contaminant / Land Use - ZONE 1A		IOC Score	VOC Score	SOC Score	Microbial Score
Land Use Zone 1A	IRRIGATED CROPLAND	2	2	2	2
Farm chemical use high	YES	2	0	2	
IOC, VOC, SOC, or Microbial sources in Zone 1A	NO	NO	NO	NO	NO
Total Potential Contaminant Source/Land Use Score - Zone 1A		4	2	4	2
Potential Contaminant / Land Use - ZONE 1B					
Contaminant sources present (Number of Sources)	YES	50	48	48	8
(Score = # Sources X 2 ) 8 Points Maximum		8	8	8	8
Sources of Class II or III leacheable contaminants or 4 Points Maximum	YES	8	6	6	
Zone 1B contains or intercepts a Group 1 Area	YES	4	4	4	
Land use Zone 1B Greater Than 50% Irrigated Agricultural Land		2	0	0	0
		4	4	4	4
Total Potential Contaminant Source / Land Use Score - Zone 1B		18	16	16	12
Potential Contaminant / Land Use - ZONE II					
Contaminant Sources Present	YES	2	2	2	
Sources of Class II or III leacheable contaminants or	YES	1	1	1	
Land Use Zone II 25 to 50% Irrigated Agricultural Land		1	1	1	
Potential Contaminant Source / Land Use Score - Zone II		4	4	4	0
Potential Contaminant / Land Use - ZONE III					
Contaminant Source Present	YES	1	1	1	
Sources of Class II or III leacheable contaminants or	YES	1	1	1	
Is there irrigated agricultural lands that occupy > 50% of	YES	1	1	1	
Total Potential Contaminant Source / Land Use Score - Zone III		3	3	3	0
Cumulative Potential Contaminant / Land Use Score		29	25	27	14
4. Final Susceptibility Source Score		16	15	15	15
5. Final Well Ranking		High	High	High	High